


# ANTON CIRCUIT PLAN

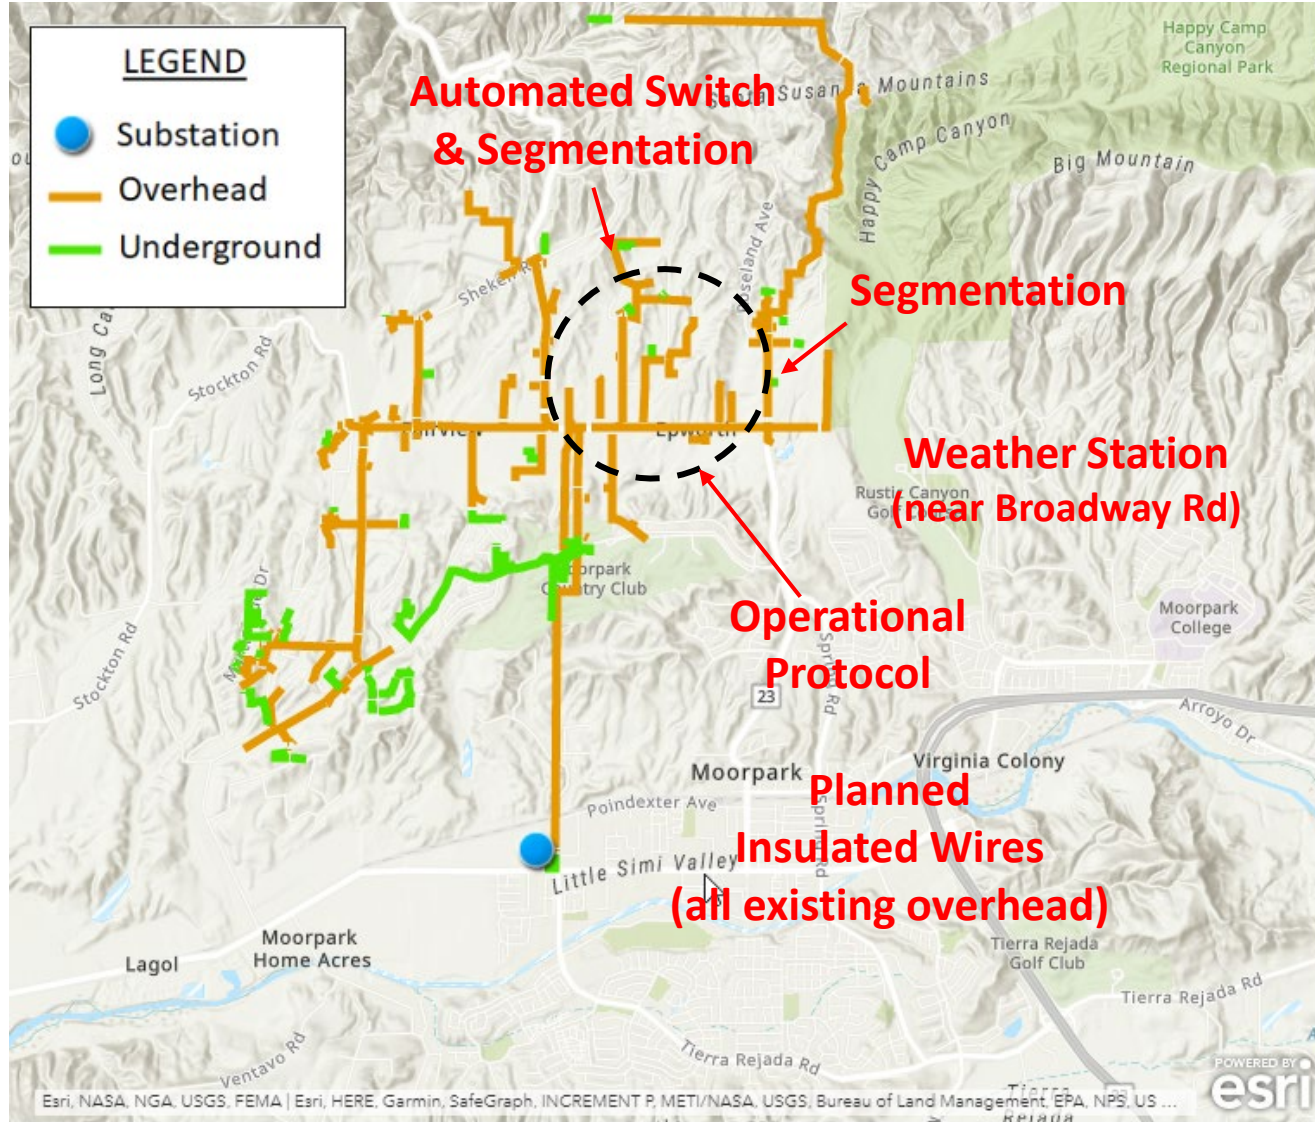

## Planned Work:

- Replace 24 miles of existing overhead wire with new insulated wire
- Install an additional weather station
- Install 1 automated switch and implement additional segmentation
- Implement operational protocol to raise PSPS windspeed thresholds

## Expected Improvements:

- **59% reduction** in customer outage time, assuming the same weather conditions in 2020