


# Balcom Circuit Plan

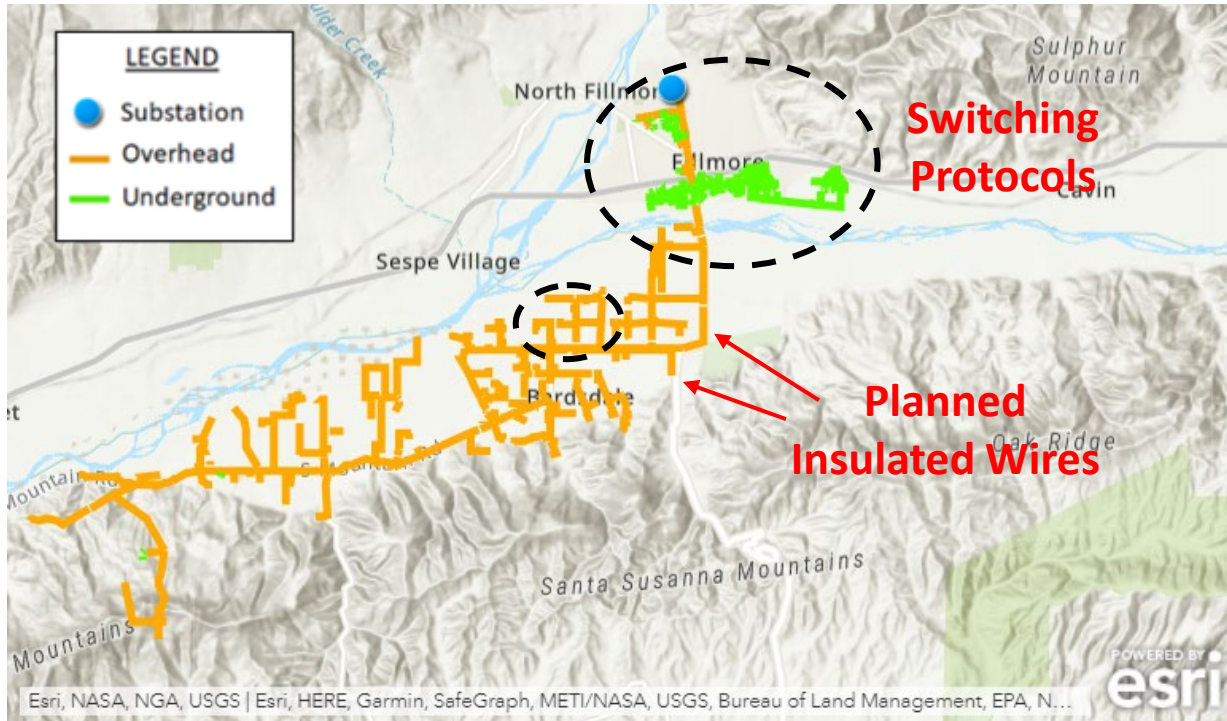

## Planned Work:

- Replace 2.6 miles of existing overhead wire with new insulated wire
- Implement switching protocols to transfer load to a less affected circuit.

## Expected Improvements:

- **28% reduction** in customer outage time, assuming the same weather conditions in 2020