


# Casmalia Circuit Plan

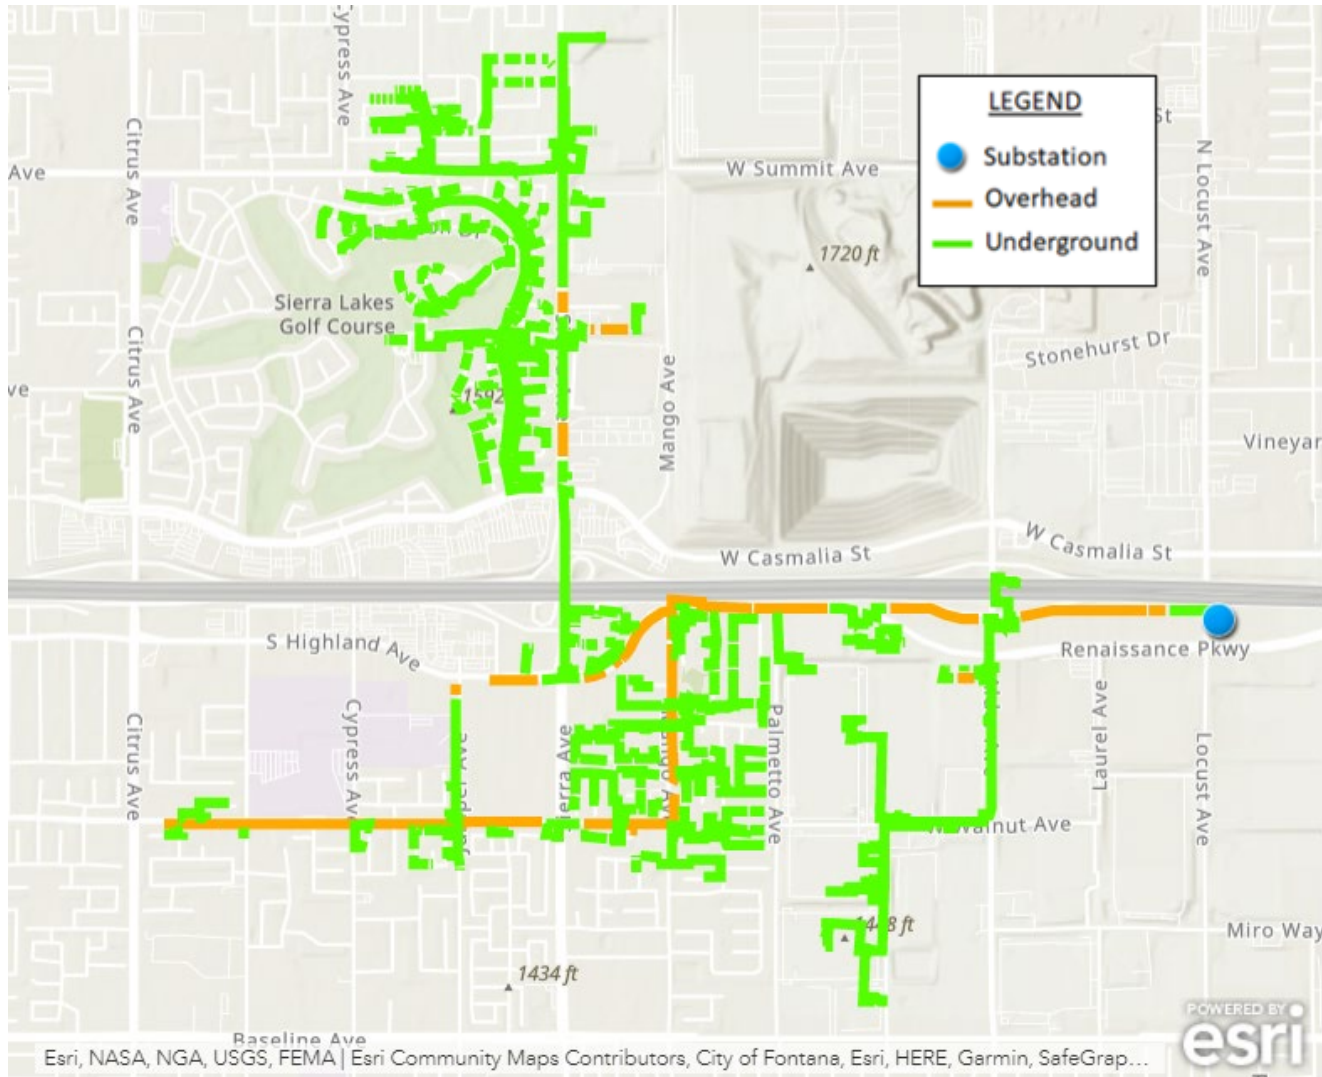

## Planned Work:

- All existing overhead in HFRA was previously switched to the Impala 12kV

## Expected Improvements:

- **100% reduction** in customer outage time, since the entire Casmalia circuit is no longer in HFRA and subject to PSPS