


Club Oaks Circuit Plan

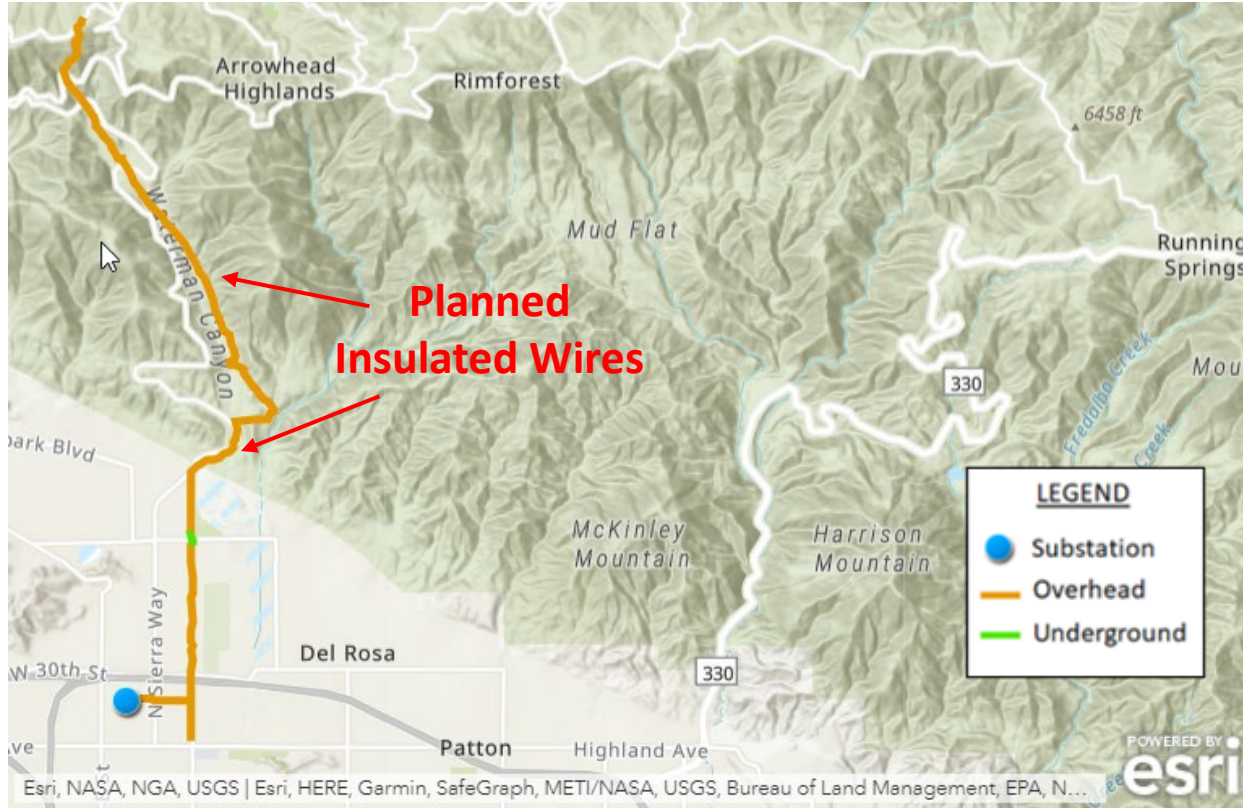

Planned Work:

- Replace 12.6 miles of existing overhead wire with new insulated wire
- Implement switching protocols to transfer load to a less affected circuit

Expected Improvements:

- Unknown at this time – will be assessed based on performance observed in 2021 PSPS season