


De Mille Circuit Plan

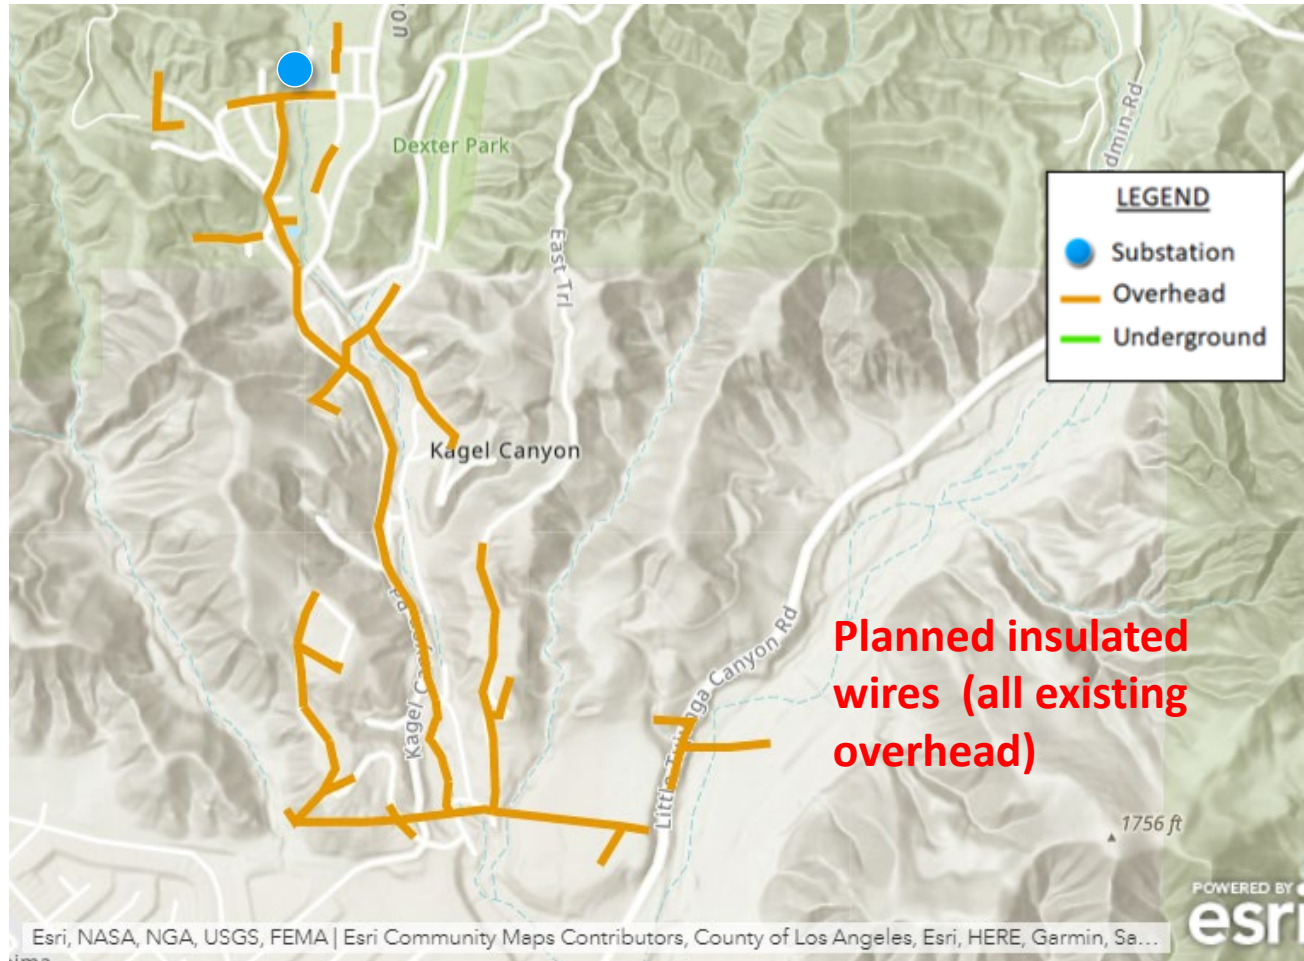

Planned Work:

- Insulated Wires: Replace 4.2 miles of existing overhead wire with new insulated wire
- Circuit will be cutover to Lopez 16kV which will have higher PSPS thresholds

Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020