


# EASTER CIRCUIT PLAN

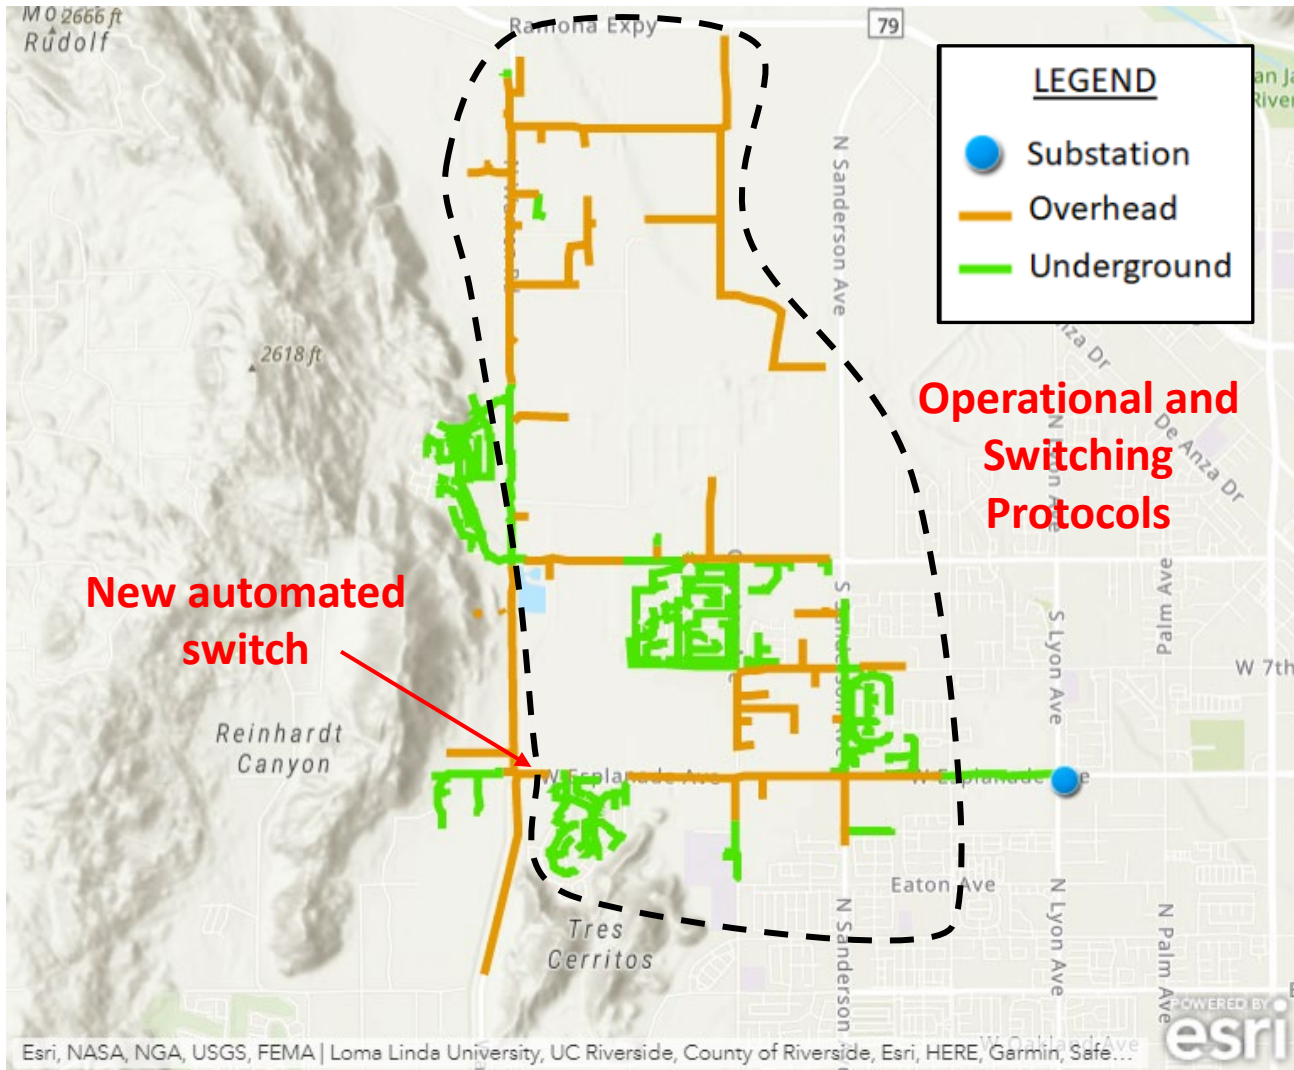

## Planned Work:

- Implement switching protocols to transfer load to a less affected circuit
- Implement operational protocol to raise PSPS windspeed thresholds
- Install a new automated switch

## Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020