


Huckleberry Circuit Plan

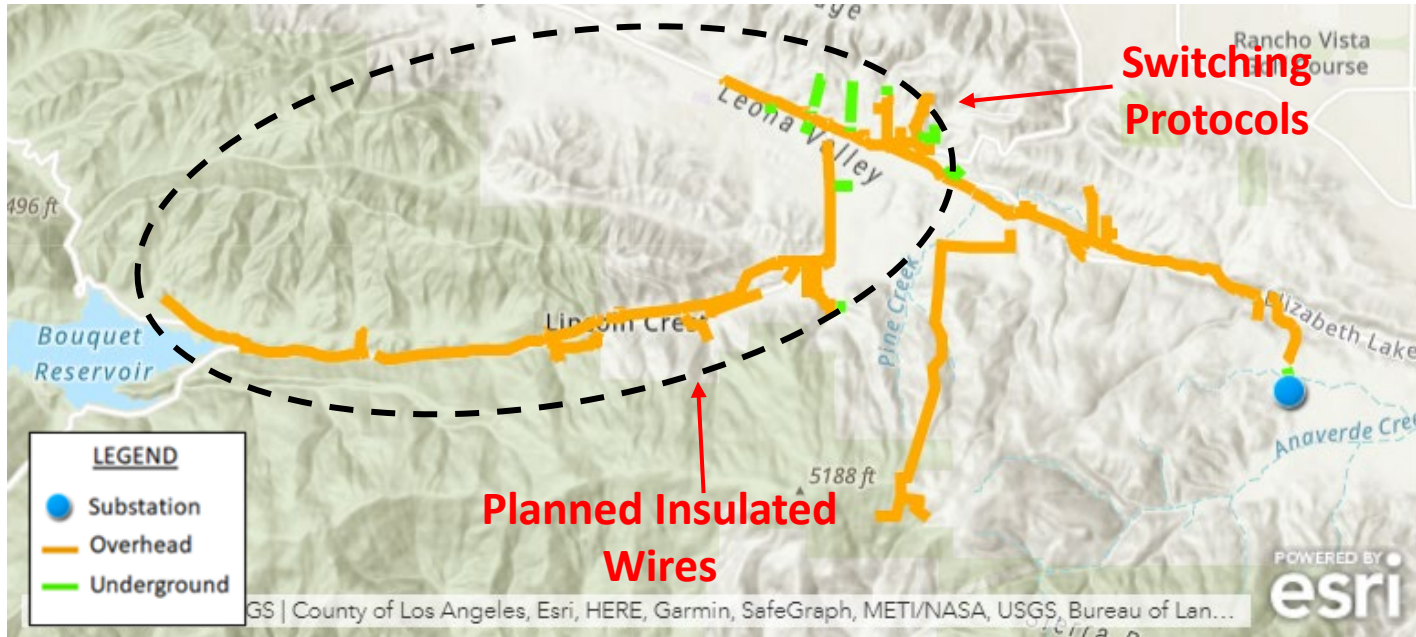

Planned Work:

- Insulated Wires: Replace 17.8 miles of existing overhead wire with new insulated wire
- Switching Protocols: Implement protocols to transfer load to a less affected circuit

Expected Improvements:

- While this circuit did not experience a PSPS event in 2020*, the planned work is expected to reduce the impact of PSPS in the future

*The Huckleberry circuit had PSPS-related outages in 2019, but not in 2020.