


NAPA CIRCUIT PLAN

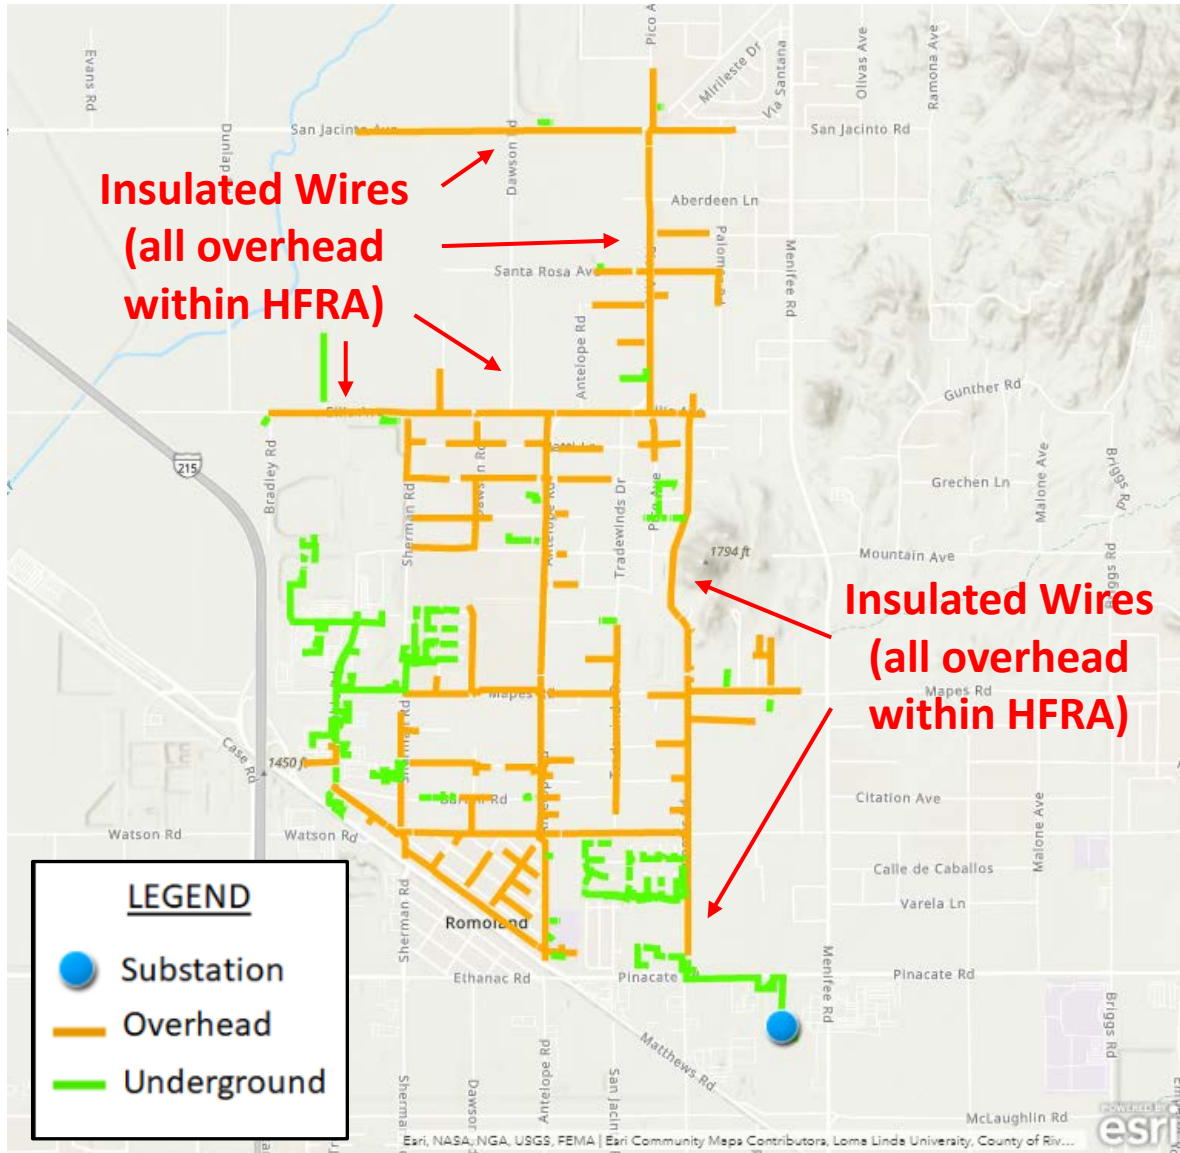

Planned Work:

- Replace approximately 7.2 miles of existing overhead wire with new insulated wire

Expected Completion Date:

- 2022

Expected Improvements:

- When the upgrades are completed in 2022, a **100% reduction** in customer outage time is expected assuming the same weather conditions in 2020

Note: because of sectionalization on the Napa circuit, no customer on the circuit experienced four or more PSPS outages since 2019. Since four or more outages is the basis for expedited grid hardening prioritization, implementation of this plan is scheduled to take place in 2022.