


Northpark Circuit Plan

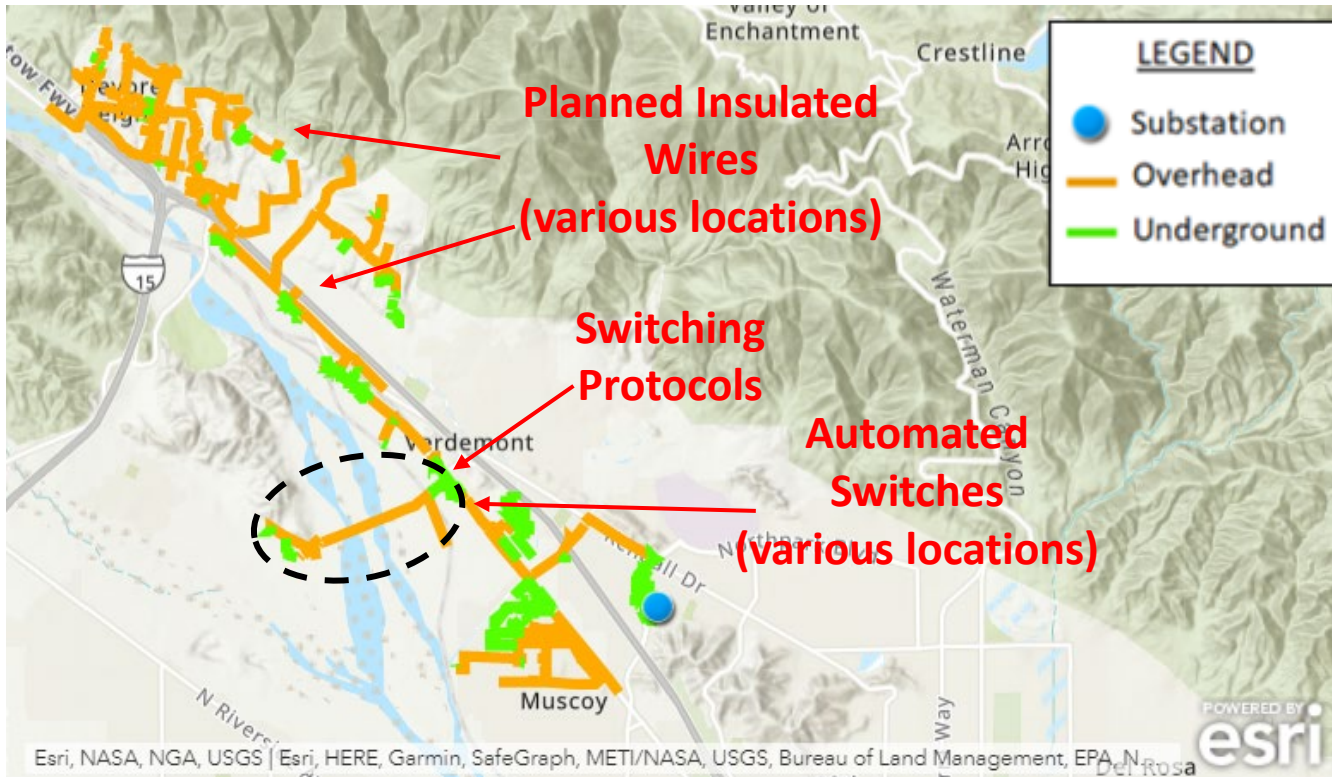

Planned Work:

- Replace 20.1 miles of existing overhead wire with new insulated wire
- Implement switching protocols to transfer load to a less affected circuit
- Automate 3 existing sectionalizing devices

Expected Completion Date:

- September 2021

Expected Improvements:

- **100% reduction** in customer outage time, assuming the same weather conditions in 2020