
Appendix A – WDAT920




Queue Cluster 5 Phase I Report

January 30, 2013

This study has been completed in coordination with the California Independent System Operator (CAISO) per CAISO Tariff Appendix DD Generator Interconnection and Deliverability Allocation Procedures (GIDAP)

Table of Contents

A. Executive Summary	1
B. Project and Interconnection Information	2
C. Interconnection Facilities, Network Upgrades, and Distribution Upgrades	5
D. Cost and Construction Duration Estimates	7
E. Study Assumptions	8
F. Deliverability Assessment	8
G. Power Flow Analysis	8
H. Short Circuit Analysis.....	10
I. Reactive Power Deficiency Analysis	12
J. Transient Stability Evaluation.....	13
K. Evaluation/Permitting	13
L. Items not covered in this study	13

Attachments:

1. Allocation of Network Upgrades for Cost Estimates
2. Escalated Cost and Time to Construct for Interconnection Facilities, Reliability Network Upgrades, Delivery Network Upgrades, and Distribution Upgrades
3. Interconnection Handbook
4. Short Circuit Calculation Study Results (see Appendix H of the group report)
5. Not Used
6. Generator Dynamic Data
7. SCE Northern Hemisphere Import Nomogram

A. Executive Summary

[REDACTED], an Interconnection Customer (IC), has submitted a completed Interconnection Request (IR) to the Southern California Edison Company (SCE) for their proposed [REDACTED] Project) under the terms of SCE's Wholesale Distribution Access Tariff (WDAT). The Project is a Full Capacity Deliverability Status, Solar Photovoltaic (PV) Plant with a total rated output of 14 MW to the proposed Point of Interconnection (POI) at Southern California Edison Company's (SCE) Great Lakes-Rosamond 66 kV Line in Kern County, California. The customer has requested a proposed In-Service Date of March 1, 2014 and a proposed Commercial Operation Date of [REDACTED].

In accordance with Federal Energy Regulatory Commission (FERC) approved Generator Interconnection and Deliverability Allocation Procedures (GIDAP) (CAISO Tariff Appendix DD), the Project was grouped with Queue Cluster 5 Phase I (QC5) study projects to determine the impacts of the group as well as impacts of the Project on the CAISO Controlled Grid.

The group report has been prepared separately identifying the combined impacts of all projects in the group on the CAISO Controlled Grid. This report focuses only on the impacts of this Project.

The report provides the following:

1. Transmission system impacts caused by the Project;
2. System reinforcements necessary to mitigate the adverse impacts caused by the Project under various system conditions;
3. A list of required facilities and a good faith estimate of the Project's cost responsibility and time required to construct and bring these facilities into service.

The QC5 study has determined that the Project contributes to various reliability and/or deliverability problems for which mitigation plans have been proposed. These mitigation plans are detailed in Section C of this report. The cost responsibility and estimated time to construct¹ the facilities required for the Project are summarized below.

The good faith cost estimates of Interconnection Facilities² (IF) and Distribution Upgrades³ to interconnect the Project are:

Interconnection Facilities	\$2,638,000
ITCC for Interconnection Facilities	\$923,000
Distribution Upgrades to support interconnection	\$12,278,000
ITCC for Distribution Upgrades to support interconnection	\$4,285,000

The non-binding cost estimate of Interconnection Facilities (IF) and Distribution Upgrades to interconnect the Project is approximately \$3,561,000 and \$16,563,000 respectively, including ITCC⁴.

¹ Construction is only part of the duration of months specified in the study, includes final engineering, licensing, etc, and other activities required to bring such facilities into service.

² The transmission facilities identified between the generation facility and the point of interconnection necessary to physically and electrically interconnect the Project to the CAISO-Controlled Grid.

³ These upgrades are not part of the CAISO Controlled Grid, and are not reimbursable.

⁴ Income Tax Component of Contribution. The ITCC included in this cost estimate was computed using a 35% rate.

The good faith cost estimate for the allocated Reliability Network Upgrades⁵ (RNUs) necessary to interconnect the project is \$0.

There were no Local Delivery Network Upgrades⁶ (LDNUs) identified or allocated in this Phase I study in order to provide the Full Capacity Deliverability Status requested in the Interconnection Request.

The good faith estimated cost for Area Delivery Network Upgrades^{7,8} (ADNUs) is \$7,221,000. The good faith estimated cost for Distribution Upgrades needed to support the ADNUs is \$1,669,000.

The non-binding estimated time to interconnect the project and construct the facilities corresponding with the mitigation plans associated to the Project is as follows:

<u>Facility Type</u>	<u>Duration (Months)</u>
Interconnection Facilities	27
Distribution Upgrades to support interconnection	27
Reliability Network Upgrades	NA
Local Delivery Network Upgrades	NA
Area Delivery Network Upgrades	115
Distribution Upgrades to support ADNU	115

These durations are from the execution of the Generator Interconnection Agreement, receipt of: all required information, funding, and written authorization to proceed from the IC as will be specified in the Generator Interconnection Agreement to commence the work.

The QC5 study determined that this Project is dependent on queued ahead upgrades being in place prior to interconnection of the Project. The estimated time to construct QC5 Phase I upgrades specified above do not take into account the time to construct queued ahead upgrades.

B. Project and Interconnection Information

The Project's general information, as stated in the IR provided by the IC, and Interconnection Facilities are illustrated below in Table B.1, Figure B.1 provides the map for the Project and the transmission facilities in the vicinity, and Figure B.2 shows the conceptual single line diagram of the Project as modeled in the study.

⁵ The SCE transmission facilities, other than Interconnection Facilities, at or beyond the point of interconnection necessary to physically and electrically interconnect the Project, needed to maintain system integrity and reliability.

⁶ The SCE transmission facilities, other than Interconnection Facilities, at or beyond the point of interconnection necessary to physically and electrically interconnect the Project, and are network upgrades built to address local deliverability constraints for projects that request Full or Partial Capacity Deliverability Status

⁷ The SCE transmission facilities, other than Interconnection Facilities, at or beyond the point of interconnection necessary to physically and electrically interconnect the Project, and are network upgrades built to address area deliverability constraints for projects that request Full or Partial Capacity Deliverability Status.

⁸ The CAISO developed the \$/MW cost rate for incremental Area Delivery Network Upgrades. The cost rate multiplied by the requested deliverable MW capacity provides the cost estimate for the Area Delivery Network Upgrades.


Table B.1: Project General Information

Project Location	[REDACTED] Kern County
Participating TO's Planning Area	SCE Northern System
Number and Type of Generators	[REDACTED]
Interconnection Voltage	66 kV
Maximum Generator Output	14 MW
Generator Auxiliary Load	0.2 MW
Maximum Net Output to Grid	14 MW
Power Factor Range	Lead 0.95 / Lag 0.95
Step-up Transformer(s)	<p>Main Transformer 66/34.5 kV (YG-YG-Delta [H-X-Y]), 9/12/15 MVA H-X Impedance Value: 8 % @ 15 MVA H-Y Impedance Value: 5 % @ 15 MVA X-Y Impedance Value: 8 % @ 15 MVA</p> <p>Padmount Transformer: 34.5/0.480 kV (D-Y), 1.00 MVA H-X Impedance Value: 5.75 % @ 1.00 MVA</p>
Point of Interconnection	Participating TO's Great Lakes-Rosamond 66 kV line
Interconnection Customer Requested Commercial Operation Date	[REDACTED]

Figure B.1: Map of the Project



Figure B.2: Proposed Single Line Diagram

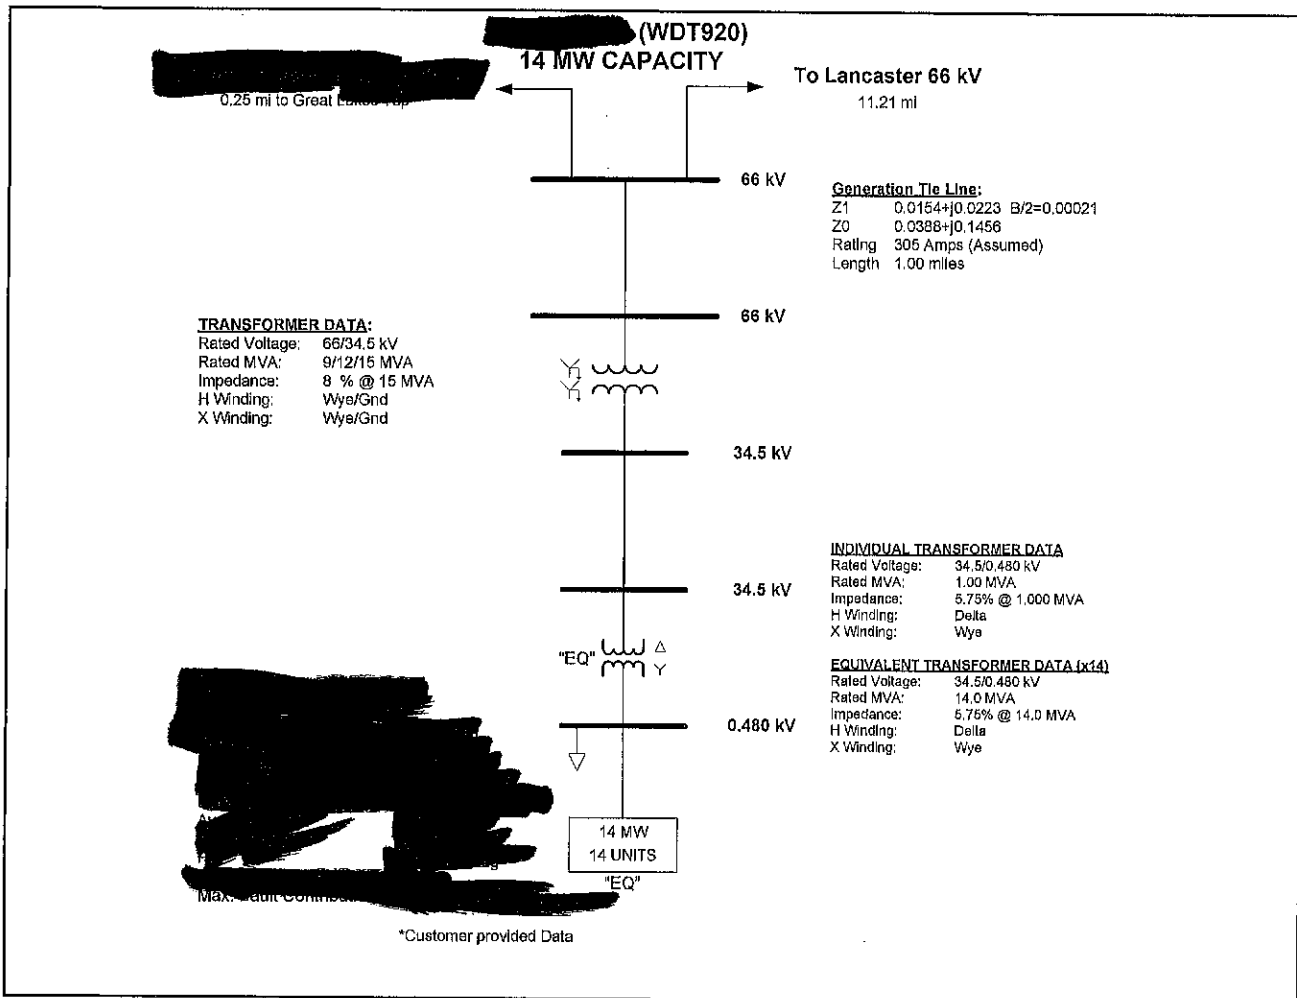

C. Interconnection Facilities, Network Upgrades, and Distribution Upgrades

To determine the cost responsibility of each generation project in QC5, the CAISO developed cost allocation factors (Attachment 1) for Reliability Network Upgrades and Local Delivery Network Upgrades. The CAISO developed the \$/MW cost rate for incremental Area Delivery Network Upgrades. The cost rate multiplied by the requested deliverable MW capacity provides the cost estimate for the Area Delivery Network Upgrades. The Interconnection Facilities are the sole cost responsibility of the Project. The Interconnection Facilities and Network Upgrades are listed below:

DISTRIBUTION PROVIDER'S INTERCONNECTION FACILITIES

1. Transmission

WDT920 66 kV Generation Tie Line

Install one (1) single circuit steel pole and approximately 200 circuit feet of overhead conductor.

2. Substation

WDT920 Substation

Install the following interconnection facility components of a new 66 kV modified ring bus structure to terminate the new WDT920 66 kV generation tie line.

The interconnection facilities will be installed as follows:

- [REDACTED] dead-end structure
- [REDACTED] voltage transformers
- Line protection relays

3. Telecommunications

Install cross connections at WDT920 and the Interconnection Facility supporting protection.

Also install all required light wage channel and related terminal equipment at each end of both FO paths to interface with the required Line Protection Relays and RTU.

4. Metering Services Organization

Install SCE revenue meters required to meter the retail load at the generating facility. The SCE meter will be installed in tandem with the ISO meter circuit.

The customer will provide the required metering equipment (voltage and current transformers and metering cabinet).

5. Power System Controls

Install [REDACTED] RTU at the generating facility to monitor typical generation elements such as MW, MVAR, terminal voltage and circuit breaker status at each generating unit and the plant auxiliary load and transmit this information to the SCE grid control center.

6. Real Properties, Transmission Planning Licensing, and Corporate Environmental Services

Obtain licensing, permits, easements, and perform all required environmental activities for the installation of the following project elements if applicable:

- Segment of 66 kV gen tie line within the new SCE 66 kV substation property
- Access easements

PLAN OF SERVICE DISTRIBUTION UPGRADES

WDT920 66 kV Substation

Install a new interconnection facility to interconnect the generation to the Great Lakes - Rosamond 66 kV line. Install the following equipment:

1. Subtransmission

- [REDACTED] tubular steel poles designed for double circuit
- Approximately 2,400 feet of 954 SAC conductor

2. Substation

WDT920 Substation

- [REDACTED] 66 kV circuit breakers
- [REDACTED] sets of 66 kV disconnect switches
- [REDACTED] potential transformers
- Mechanical electrical equipment room to house relays

Rosamond Substation

- Upgrade protection relays
- Modify points on existing RTU

3. Power System Controls

Install [REDACTED] RTU at WDT920 Substation to monitor typical generation elements such as MW, MVAR, terminal voltage and circuit breaker status at each generating unit and the plant auxiliary load and transmit this information to the SCE grid control center.

4. Real Properties, Transmission Planning Licensing, and Corporate Environmental Services

Obtain licensing, permits, easements, and perform all required environmental activities for the installation of the following project elements if applicable:

- WDT920 Substation property
- Loop in lines

RELIABILITY NETWORK UPGRADES (RNU)

No Reliability Network Upgrades were identified as part of this QC5 Phase I study for Project.

LOCAL DELIVERY NETWORK UPGRADES (LDNU)

No Local Delivery Network Upgrades were identified as part of this QC5 Phase I study for Project.

AREA DELIVERY NETWORK UPGRADES (ADNU) AND ASSOCIATED DISTRIBUTION UPGRADES USED TO DERIVE DOLLAR-PER-MW VALUE

1. Mesa 500 kV System Upgrades
2. Distribution Upgrades to Support the Mesa 500 kV System Upgrade

See group report Section K for details.

DISTRIBUTION UPGRADES

1. Antelope-Rosamond 66 kV line rebuild
2. Antelope-Del Sur-Rosamond 66 kV line rebuild

See group report Section K for details.

NOTE: The Distribution Upgrades to support the Mesa 500 kV System Upgrade are addressed in the ADNU scope and cost tables.

D. Cost and Construction Duration Estimates

To determine the cost responsibility of each generation project in QC5, the CAISO developed cost allocation factors (Attachment 1) for Reliability Network Upgrades and Local Delivery Network Upgrades. The CAISO developed the \$/MW cost rate for incremental Area Delivery Network

Upgrades. The cost rate multiplied by the requested deliverable MW capacity provides the cost estimate for the Area Delivery Network Upgrades. Attachment 2 provides the 'constant' 2012 dollars and their escalation to the estimated operating date year for Interconnection Facilities, Reliability Network Upgrades, Delivery Network Upgrades, and Distribution Upgrades which the Project was allocated cost. For the QC5 study, the estimated O.D. is derived by assuming the duration of the work element will begin in March 2014, which is the CAISO tariff scheduled completion date of the QC5 Phase II study plus 90 days for the interconnection agreement signing period.

E. Study Assumptions

For detailed assumptions, please refer to the group report. The following assumptions are only specific to the Project:

1. The following facilities will be installed by SCE and are included in this Phase I Study:

- The required Retail Meters to meter the generating facility retail load.
NOTE: SCE installation does not include metering voltage and current transformers. The SCE meters will be connected to the generator – owned voltage and current transformers to be installed for their CAISO metering.
- The required Remote Terminal Unit (RTU) to be installed at the generating facility which will be installed by SCE.

2. The following facilities are to be installed by the Interconnection Customer and are not included in this Phase I Study:

- The 66 kV generation tie line with Fiber Optic cable from the generating facility to the last structure outside the new tapped substation.
- The diverse telecommunications path from the new substation to the generator site.
- The required CAISO metering equipment (voltage and current transformers and CAISO meters).
NOTE: The metering voltage and current transformers installed for the CAISO metering will also be used for the SCE owned retail meters.
- Line protection relays to be installed at the generating facility end of the WDT920 66 kV generation tie line.
- Customer to provide a leased T1 line to support the RTU.

F. Deliverability Assessment

The deliverability assessment indicated that the Project contributes to the South of Vincent flow deliverability constraints. The South of Vincent flow limit has been identified in the previous studies as driven by the voltage stability following Lugo – Vincent 500kV No. 1 & 2 outage. It is an area deliverability constraint that impacts deliverability of generators north of Vincent. To increase the South of Vincent transfer capability, network upgrades south of Vincent are needed. For details of the area deliverability constraint, refer to the group report Section F.

Area Delivery Network Upgrade

- Mesa 500kV upgrades

G. Power Flow Analysis

1. Transmission System – 220 kV and 500 kV

The QC5 study indicated that the Project contributes to the following transmission facility overloads or non-convergence problems. The details of the analysis and overload levels are provided in the group report.

(a) Overloaded Transmission Facilities

Category “A”

- None identified

(b) Power Flow Non-Convergence

There were non-convergence issues under certain contingencies identified by the addition of this project due to the limited system capacity.

(c) Voltage Performance

With the generators providing the required power factor regulation capability (0.95 lead/lag at POI) no voltage performance issues were identified

(d) Required Mitigations

The QC5 study results indicated that to eliminate the power flow impact contributions of the QC5 generating projects including the Project, significant congestion management, together with reactive power support from all generator projects, is needed. The Area Delivery Upgrade(s) identified in Section F could alleviate the congestion to some extent. See the group report for additional details.

2. Subtransmission System – 66 kV and 115 kV

The QC5 study indicated that the Project contributes to the following subtransmission system overloads or non-convergence problems. The details of the subtransmission analysis and overload levels are provided in the group report.

(a) Overloaded Transmission Facilities

Category “A”

- None

Category “B”

- Rosamond leg of the Antelope-Del Sur-Rosamond 66 kV Line from Q650AA to the Antelope-Del Sur-Rosamond Tap
- Rosamond leg of the Antelope-Rosamond 66 kV Line from Q661 to the Rosamond 66 kV substation

Category “C”

- None

In addition to the overloads identified above, the QC5 study determined that this Project is dependent on queued ahead upgrades being in place prior to interconnection. At this time, the triggering projects for these queued ahead upgrades have not executed Generator Interconnection Agreements with SCE.

(b) Power Flow Non-Convergence

No non-convergence issues were identified.

(c) Voltage Performance

With the addition of the project and the previously proposed system upgrades in place as well as assuming each project can provide 0.95 power factor correction at their POI, no voltage performance issues were identified.

(d) Required Mitigations

The QC5 study results indicated that to eliminate the power flow impact contributions of the project, it is required to install a combination of Distribution Upgrades and Delivery Network Upgrades. See the group report for additional details.

The scope and pro rata share of the cost for the Distribution Upgrades assigned to the Project is as follows:

- **Antelope-Rosamond 66 kV line rebuild**
- **Antelope-Del Sur-Rosamond 66 kV line rebuild**
- **Allocated SCD Mitigation(s) – Refer to Section H below**

See the group report for additional details.

H. Short Circuit Analysis

Short circuit studies were performed to determine the fault duty impact of adding the QC5 projects to the Participating TO system and to ensure system coordination. The fault duties were calculated with and without the projects to identify any equipment overstress conditions. Once overstressed circuit breakers are identified, the fault current contribution from each individual project in QC5 is determined. Each project in QC5 will be responsible for its share of the upgrade cost based on the rules set forth in CAISO Tariff Appendix DD.

1. Short Circuit Study Input Data

The customer provided technical data for the identified inverter (specified in Section B). If the technical data obtained from the inverter manufacturer by SCE illustrates differences in the Short Circuit Duty (SCD) parameters, then SCE utilized the manufacturer data of the inverter model specified by the IC in the application in the SCD study. Otherwise, SCE utilized the parameters provided by the IC. The IC should verify with the manufacturer the appropriate SCD contributions of the inverter prior to commencement of the Phase II study and should update the application to reflect the appropriate data. The data provided by the IC for this project did not match the technical data obtained from the inverter manufacturer.

The following additional input data was used in this study:

Generation Step-up Transformers (total of 1)

Each transformer is a three-phase, 66/34.5 kV (YG-D), 9/12/15 MVA with the following impedance information:

- H-X: 8% @ 15 MVA
- H-Y: 5% @ 15 MVA
- X-Y: 8% @ 15 MVA

Padmount Transformers (total of 14)

Each transformer is a three-phase, 34.5/0.480 kV (D-Y), 1.0 MVA with the following impedance information:

- H-X: 5.75% @ 1.0 MVA

Generation Tie Line

The generation tie line was assumed to be 1.0 miles of 2/0 ACSR conductor.

2. Short Circuit Duty Study Results

All bus locations where the QC5 projects increase the short-circuit duty by 0.1 kA or more and where duty is in excess of 60% of the minimum breaker nameplate rating are listed in the group report Appendix H. These values have been used to determine if any equipment is overstressed as a result of the QC5 interconnections and corresponding network upgrades, if any.

The responsibility to finance short circuit related upgrades identified through a group study shall be assigned to all Interconnection Requests in that group study pro-rata on the basis of short circuit duty contribution of each Generating Facility. In addition, the SCD impact of the associated proposed Network Upgrades was allocated to each Generating Facility using the same percentage assigned for the triggered Network Upgrade.

(a) Application Queue with RNUs and LDNUs Analysis Results

Fault duties were calculated with the inclusion of the QC5 projects and the identified RNUs and LDNUs to identify the incremental impacts associated with these Facilities. As discussed in Section H of the group report, under this scenario the QC5 study breaker evaluation identified overstressed circuit breakers. The following is the pro-rata cost allocation for this project, based on SCD contribution at each location.

SCD Mitigation - Table of Network Breaker Replacements (RNU)

NA

(b) Application Queue with RNUs, LDNUs, & ADNUs Analysis Results

Fault duties were re-calculated to include the QC5 projects and the identified RNUs, LDNUs, and ADNUs from the power flow and stability analysis to identify the incremental impacts associated with these Facilities. As discussed in Section H of the group report, under this scenario the QC5 study breaker evaluation identified overstressed circuit breakers at Mira Loma and Valley. As part of this Phase I cost estimates for mitigation of short circuit duty impacts under this scenario are not included. As part of Phase II if this mitigation is identified to still be required, cost estimates and corresponding pro-rata cost allocation will be determined.

(c) Application Queue Distribution Analysis Results

Fault duties were calculated for the QC5 projects on the distribution system. Under this scenario the QC5 study breaker evaluation identified overstressed circuit breakers at the following distribution substations. The following is the pro-rata cost allocation for this project, based on SCD contribution at each location.

SCD Mitigation -Table of Distribution Breaker Replacements

NA

3. Preliminary Protection Requirements

Protection requirements are designed and intended to protect SCE's system only. The preliminary protection requirements were based upon the interconnection plan as shown in Figure B.2.

The applicant is responsible for the protection of its own system and equipment and must meet the requirements in the SCE Interconnection Handbook which is provided in Attachment 3.

I. Reactive Power Deficiency Analysis

1. Transmission System Reactive Power Deficiency Analysis

With all proposed system upgrades listed above and in Section F, the power flow studies for Category "B" and Category "C" contingencies indicated that this QC5 project did not cause voltage drops of 5% or more from the pre-project levels, or cause the SCE system to fail to meet applicable voltage criteria. This project, therefore, did not cause any adverse voltage impacts on the CAISO Controlled Grid with the proposed upgrades in place.

A more detailed reactive power deficiency analysis will need to be performed as part of the Phase II Study

2. Individual Project Power Factor Requirements

Based on the findings obtained from QC5 study analysis, it is expected that the Project will need to be designed to maintain a composite power delivery at continuous rated power at the Point of Interconnection at a power factor within the range of 0.95 leading to 0.95 lagging. This will be fully evaluated as part of the Phase II Study.

J. Transient Stability Evaluation

Limited transient stability studies were conducted using full loop base cases to ensure that the Participating TO system remains in operating equilibrium, as well as operating in a coordinated fashion; through abnormal operating conditions after the QC5 projects begin operation. The generator dynamic data used in the study for the Project is shown in (Attachment 6).

1. Transmission System – 220 kV and 500 kV

(a) Transient Stability Study Scenarios

Disturbance simulations were performed for a study period of 10 seconds to determine whether the QC5 projects will create any system instability during a variety of line and generator outages. The most critical single contingency and double contingency outage conditions in the Northern Bulk System were evaluated. For the list of specific line and generator outages evaluated, see the group report

(b) Transient Stability Study Results

The transient stability study concluded that with the addition of the QC5 projects and the proposed system upgrades in place as well as assuming each project can provide 0.95 power factor correction at their POI, the transient stability performance of the system is acceptable

2. Subtransmission System – 66 kV and 115 kV

(a) Transient Stability Study Scenarios

Disturbance simulations were performed for a study period of 10 seconds to determine whether the QC5 projects will create any system instability during a variety of line and generator outages. The most critical single contingency outage conditions in the Antelope subtransmission system were evaluated.

For the list of specific line and generator outages evaluated, see the group report.

(b) Transient Stability Study Results

Limited stability analysis was performed for the Antelope subtransmission system to identify “relative” as opposed to “absolute” conclusions regarding the stability impacts of the QC5 queued generation projects. The transient stability study concluded that with the addition of the project and the proposed system upgrades in place as well as assuming each project can provide 0.95 power factor correction at their POI, the transient stability performance of the system is acceptable.

Stability plots are shown in Appendix F of the group report.

K. Evaluation/Permitting

Please see Section L of the QC5 group report.

L. Items not covered in this study

1. Conceptual Plan of Service

The results provided in this study are based on conceptual engineering and a preliminary plan of service and are not sufficient for permitting of facilities. The Plan of Service is subject to change as part of the Phase II Interconnection Study.

2. Customer's Technical Data

Additional technical data related to the Interconnection Customer's project may be required as part of the Phase II study. The study accuracy and results for the QC5 Phase I Study are contingent upon the accuracy of the technical data provided by the Interconnection Customer. Any changes from the data provided could void the Study results.

3. Study Impacts on Neighboring Utilities

Results or consequences of this QC5 Phase I Study and/or to-be-performed Phase II Interconnection Study may require additional studies, facility additions, and/or operating procedures to address impacts to neighboring utilities and/or regional forums. For example, impacts may include but are not limited to WECC Path Ratings, short circuit duties outside of the CAISO Controlled Grid, and sub-synchronous resonance (SSR).

4. Use of Participating TO Facilities

The Interconnection Customer is responsible for acquiring all property rights necessary for the Interconnection Customer's Interconnection Facilities, including those required to cross Participating TO facilities and property. This Interconnection Study does not include the method or estimated cost to the Interconnection Customer of Participating TO mitigation measures that may be required to accommodate any proposed crossing of Participating TO facilities. The crossing of Participating TO property rights shall only be permitted upon written agreement between Participating TO and the Interconnection Customer at Participating TO's sole determination. Any proposed crossing of Participating TO property rights will require a separate study and/or evaluation, at the Interconnection Customer's expense, to determine whether such use may be accommodated.

5. Participating TO Interconnection Handbook

The Interconnection Customer shall be required to adhere to all applicable requirements in the Participating TO Interconnection Handbook. These include, but are not limited to, all applicable protection, voltage regulation, VAR correction, harmonics, switching and tagging, and metering requirements.

6. Western Electricity Coordinating Council (WECC) Policies

The Interconnection Customer shall be required to adhere to all applicable WECC policies including, but not limited to, the WECC Generating Unit Model Validation Policy.

7. System Protection Coordination

Adequate Protection coordination will be required between Participating TO-owned protection and Interconnection Customer-owned protection. If adequate protection coordination cannot be achieved, then modifications to the Interconnection Customer-owned facilities (i.e., Generation-tie or Substation modifications) may be required to allow for ample protection coordination.

8. Standby Power and Temporary Construction Power

The QC5 Phase I Study does not address any requirements for standby power or temporary construction power that the Project may require prior to the In-Service Date of the Interconnection Facilities. Should the Project require standby power or temporary construction power from Participating TO prior to the In-Service Date of the Interconnection Facilities, the IC is responsible to make appropriate arrangements with Participating TO to receive and pay for such retail.

9. Licensing Cost and Duration Estimate (Estimated Construction Schedule)

The estimated licensing cost and durations applied to this project are based on the project scope details presented in this study. These estimates are subject to change as project environmental and real estate elements are further defined. Upon execution of the

Interconnection Agreement, additional evaluation including but not limited to preliminary engineering, environmental surveys, and property right checks may enable licensing cost and/or duration updates to be provided.

10. Network/Non-Network Classification of Telecommunication Facilities

The cost for telecommunication facilities that were identified as part of the IC's Interconnection Facilities was based on an assumption that these facilities would be sited, licensed, and constructed by the IC. The IC will own, operate, maintain, and construct diverse telecommunication paths associated with the IC's gen tie, excluding terminal equipment at both ends. In addition, the telecommunication requirements for SPS were assumed based on tripping of the generator breaker as opposed to tripping the circuit breakers at the Participating TO substation. Due to uncertainties related to telecommunication upgrades for the numerous projects in queue ahead of QC5 Phase I, telecommunication upgrades for higher queued projects were not considered in this study. Depending on the outcome of interconnection studies for higher queued projects, the telecommunication upgrades identified for QC5 Phase I may be reduced. Any changes in these assumptions may affect the cost and schedule for the identified telecommunication facilities.

11. Applicability

This document has been prepared to identify the impact(s) contributions of the Project on the SCE electrical system; as well as establish the technical requirements to interconnect the Project to the Point of Interconnection that was evaluated in the QC5 Phase I Study for the Project. Nothing in this report is intended to supersede or establish terms/conditions specified in interconnection agreements agreed to by SCE, CAISO and the Interconnection Customer.

Attachment 1

Allocation of Network Upgrades for Cost Estimates

Table 1: Allocation of ADNU cost and Associated Distribution Upgrade Cost

Upgrades	Type	Needed For	MW	Cost Rate (\$1000/MW)	Allocated Cost (\$1000)
Mesa 500kV upgrades	ADNU	South of Vincent flow limit due to voltage instability	14	\$ 515.80	\$ 7,221.17
Distribution relocation	Distribution	South of Vincent flow limit due to voltage instability	14	\$ 119.20	\$ 1,668.80

Attachment 2

Escalated Cost and Time to Construct for Interconnection Facilities, Reliability Network Upgrades, Delivery Network Upgrades, and Distribution Upgrades

Please refer to separate document.

Attachment 3

Participating TO Interconnection Handbook

Preliminary Protection Requirements for Interconnection Facilities are outlined in the Participating TO Interconnection Handbook.

Attachment 4

Short Circuit Calculation Study Results

Please refer to the Appendix H of the group report.

Attachment 5

Not Used

Attachment 6

Customer Provided Project Dynamic Data

The following data was submitted by the Interconnection Customer for Dynamic simulation:

epcgen 90104 "WELDPV_GEN " 0.48 "1 " : #7 mva=14.0000 "solaron.p" 3.0000 "rsrc" 0.0000 "xsrc"
0.0000 "Vratio" 1.2254 "Iratio" 1.0688 "Tdc" 0.0030 "Kpdc" 1.8000 "Kidc" 22.5000 "Kpq" 0.4000 "Kiq"
25.0000 /
"Ilim" 1.1200 "OV1L" 1.2000 "OV1T" 0.0200 "OV2L" 1.1000 "OV2T" 2.5000 "UV1L" 0.5000 "UV1T" 0.1600
"UV2L" 0.8800 "UV2T" 5.0000 "OFL" 60.5000 /
"OFT" 0.0200 "UFL" 57.0000 "UFT" 0.0200

Attachment 7

SCE Northern Hemisphere Import Nomogram

Please refer to separate document.